
CHULA VISTA FIRE DEPARTMENT

FIRE PREVENTION DIVISION

Riser Room (top view)

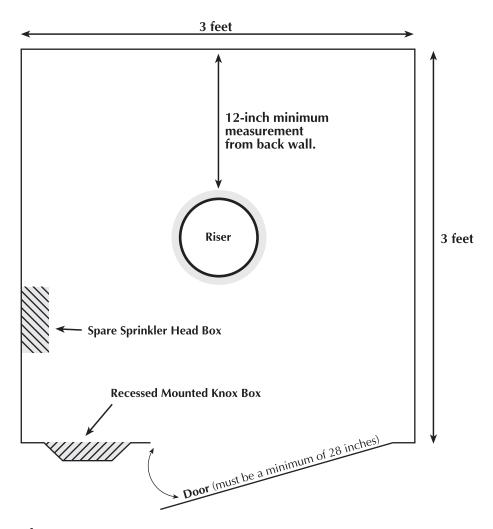

PIV/FDC Specifications

- 1. Measurements MUST be exact and will be subject to a field inspection
- 2. Lighting is required on emergency back-up
- 3. Door must be marked "FIRE SPRINKLER RISER ROOM" in 4-inch letters
- 4. Center riser in the room*

*NOTE: For multiple risers in a room, the room dimension must be no less than 18 inches from appurtunances in all directions (to be approved by Fire Department.)

